

TFP OIL HEATERS WITH 6 CRISS-CROSS ELEMENTS USED IN 3" SIZE FLANGE

WIRING & INSTALLATION

1. LINE INPUT WIRING TO HEATER MUST BE INSTALLED AND SIZED FOR CURRENT CARRYING CAPACITY IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC), NFPA 70/79, & LOCAL CODES. USE WIRES SUITABLE FOR AT LEAST 90C (194F). IF IN DOUBT, CONSULT A QUALIFIED ELECTRICIAN BEFORE WIRING OR CALL TEMPCO AT 800-323-6859.
2. IF ELEMENT WATTAGES OR VOLTAGE RATINGS ARE NOT EQUAL, HEATERS MUST NOT BE CONNECTED IN SERIES.
3. IF CORROSIVE OR HAZARDOUS VAPORS OR LIQUIDS ARE PRESENT, ELECTRICAL WIRING TO HEATER SHOULD BE ENCLOSED IN RIGID CONDUIT OR SEALED FLEXIBLE HOSE TO KEEP CONTAMINANTS OUT OF THE TERMINAL HOUSING. IF HIGH HUMIDITY IS ENCOUNTERED, THE CONDUIT & CONNECTIONS SHOULD SLOPE DOWN AND AWAY FROM THE HEATER.
4. IF FLEXIBLE CORD IS EMPLOYED, A WATERTIGHT CONNECTOR SHOULD BE USED FOR ENTRY OF THE CORD INTO THE TERMINAL BOX. OUTDOOR APPLICATIONS REQUIRE LIQUID-TIGHT CONDUIT AND CONNECTORS.
5. INSTALL POWER WIRING INTO TERMINAL HOUSING USING CONDUIT OPENING(S) PROVIDED WITH APPROVED STRAIN RELIEF CONNECTIONS. CONNECT LINE WIRES TO BUSSED TERMINALS AS SHOWN IN PROPER WIRING DIAGRAM.
6. BE SURE INSTALLATION IS PROPERLY GROUNDED THROUGH GROUNDING MEANS PROVIDED.

OPERATION & MAINTENANCE


1. DO NOT OPERATE HEATERS AT VOLTAGES IN EXCESS OF THAT STAMPED ON THE HEATER.
2. UL RECOGNIZED FLANGE HEATERS MUST NOT EXCEED 125C (257F) HEATED OIL TEMPERATURE WHEN MARKED.
3. ASA PRESSURE RATED TFP FLANGE HEATERS HAVE BEEN TESTED BY UL FOR A MAXIMUM OF 150 PSIG FOR USE IN OIL.
4. ALWAYS MAINTAIN A MINIMUM OF 2" OF OIL ABOVE THE HEATED PORTION OF THE ELEMENT TO PREVENT EXPOSURE OF THE EFFECTIVE HEATED LENGTH. IF THE HEATER IS NOT PROPERLY SUBMERGED, IT MAY OVERHEAT CAUSING A FIRE HAZARD AND SHORTEN HEATER LIFE. DO NOT OPERATE HEATER IF PARTIALLY SUBMERGED OR DRY.
5. BLEED ALL TRAPPED AIR OUT OF HEATER CHAMBER AND LIQUID PIPING IN CLOSED SYSTEMS PRIOR TO ENERGIZING HEATER. SYSTEM MUST BE KEPT FILLED WITH LIQUID DURING HEATER OPERATION.
6. HEATER MUST BE INSTALLED IN A MANNER TO MINIMIZE EXCESSIVE SCALE BUILDUP ON ELEMENTS AND MOUNTED ABOVE SEDIMENT DEPOSITS.

OPERATION USING A THERMOSTAT(IF PROVIDED)

1. MAXIMUM THERMOSTAT TEMPERATURE SETTING (C/O POINT) FOR UL RECOGNIZED OIL HEATERS IS 250F (121C)
2. DO NOT USE A THERMOSTAT AS A POWER SWITCH. USE SOME OTHER MEANS OF DISCONNECTING POWER TO THE HEATER FOR SERVICING.
3. THERMOSTATS ARE NOT A FAIL-SAFE DEVICE. USE AN APPROVED TEMPERATURE LIMIT, PRESSURE/FLOW, OR LEVEL CONTROL FOR SAFE OPERATION IN SERIES WITH THE THERMOSTAT OR PREFERABLY ON A SEPARATE INDEPENDENT CIRCUIT.
4. AVOID KINKING OR BENDING THE CAPILLARY TUBE TOO SHARPLY AS THIS WILL ALTER THE CALIBRATION AND/OR RENDER THE THERMOSTAT INOPERABLE.
5. EXCESS CAPILLARY TUBE SHOULD BE COILED NEATLY IN JUNCTION BOX. THE CAPILLARY TUBE MUST NEVER TOUCH THE HEATER OR THERMOSTAT TERMINALS AS THIS WILL CAUSE AN ELECTRICAL SHORT CAPABLE OF HARMING PERSONNEL AND/OR EQUIPMENT.
6. SEE SPECIFIC INSTRUCTION SHEET FOR SPST OR DPST THERMOSTAT MODEL BEING INSTALLED.
7. IF HEATER VOLTAGE OR AMPERAGE EXCEEDS THERMOSTAT RATING, IT MUST BE CONNECTED TO OPERATE AN EXTERNAL CONTACTOR COIL AND NOT CONNECTED DIRECTLY IN LINE WITH HEATER. INSTALL PER PROPER WIRING DIAGRAM.

WARNING! HAZARD OF ELECTRIC SHOCK. DISCONNECT POWER BEFORE SERVICING OR INSTALLING HEATER. INSTALLATION MUST BE GROUNDED TO EARTH TO AVOID SHOCK HAZARD.

TYPICAL WIRING - 6 CRISS-CROSS ELEMENTS

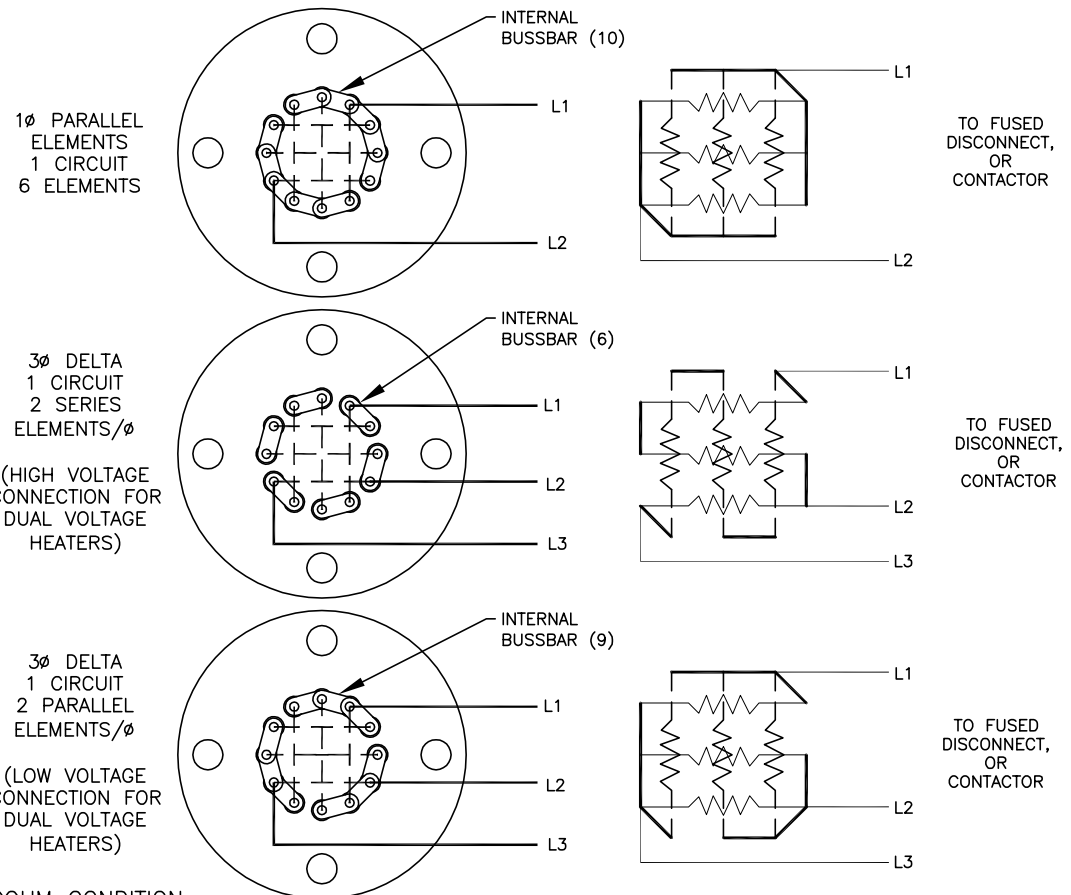

1∅ PARALLEL
ELEMENTS
1 CIRCUIT
6 ELEMENTS

3∅ DELTA
1 CIRCUIT
2 SERIES
ELEMENTS/∅

(HIGH VOLTAGE
CONNECTION FOR
DUAL VOLTAGE
HEATERS)

LOW MEGOHM CONDITION

THE REFRACTORY MATERIAL USED IN ELECTRIC HEATERS MAY ABSORB MOISTURE DURING TRANSIT OR WHEN SUBJECTED TO A HUMID ENVIRONMENT FOR EXTENDED PERIODS. IF MOISTURE ABSORPTION RESULTS IN A COLD INSULATION RESISTANCE DOWN TO 10-15 MEGOHMS, THE HEATER WILL NORMALLY CORRECT ITSELF UPON A FIRST "SOFT START" HEATUP AND DOES NOT AFFECT HEATER EFFICIENCY OR LIFE. A LOW MEGOHM CONDITION CAN EASILY BE CORRECTED BY REMOVING THE TERMINAL ENCLOSURE, THERMOSTAT, AND TERMINAL HARDWARE AND BAKING THE HEATER IN AN OVEN AT 250° TO 300°F FOR SEVERAL HOURS, PREFERABLY OVERNIGHT. ALTERNATIVE PROCEDURE IS TO REMOVE THE THERMOSTAT AND ENERGIZE THE HEATER ELEMENTS AT LOW VOLTAGE UNTIL THE MEGOHM READING INCREASES TO AT LEAST 25-50 MEGOHMS. IF MEGOHM READING DOES NOT RISE PROPERLY, CONTACT TEMPCO FOR ASSISTANCE. WHEN ENERGIZING HEATERS IN AIR, THE SHEATH TEMPERATURES SHOULD NOT EXCEED 400°F FOR COPPER AND 750°F FOR STEEL OR INCOLOY ELEMENTS.

SEE REVERSE SIDE
FOR HEATER WIRING
SCHEMATICS USING
THERMOSTATS

TITLE: TFP HEATER WIRING INSTRUCTIONS 6 ELEMENTS CRISS-CROSS DESIGN WITH AND WITHOUT THERMOSTATS			
DRAWN BY: TJL		APPROVED: GDS	
REV: 1		DATE: 5/8/14	
SHEET 1 of 2		DRAWING NUMBER: IDP-135-103	

TEMPCO
www.tempeco.com


TEMPCO Electric Heater Corporation
607 N. Central Ave.
Wood Dale, IL 60191-1452 U.S.A.
Email: info@tempco.com

TFP OIL HEATERS WITH 6 CRISS-CROSS ELEMENTS


USED IN 3" SIZE FLANGE

TYPICAL WIRING - 6 CRISS-CROSS ELEMENTS

TYPICAL WIRING USING A DOUBLE POLE THERMOSTAT

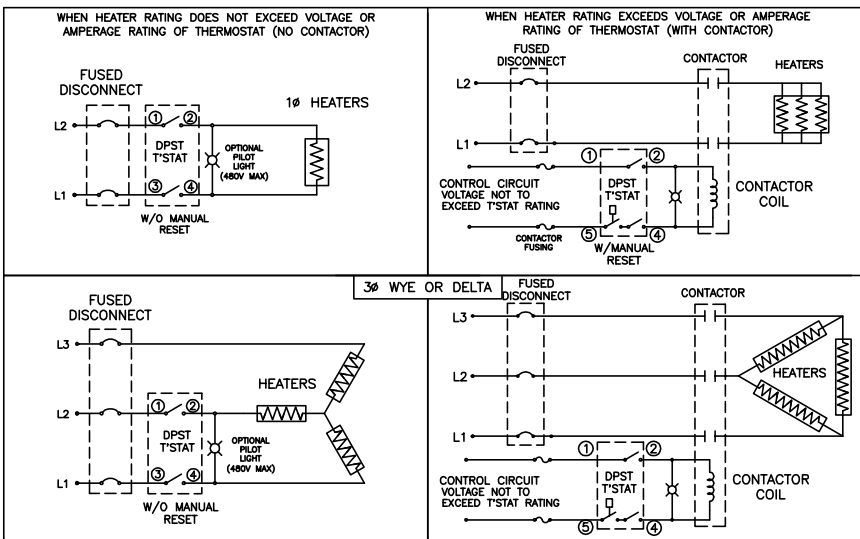


TYPICAL WIRING USING A SPST THERMOSTAT

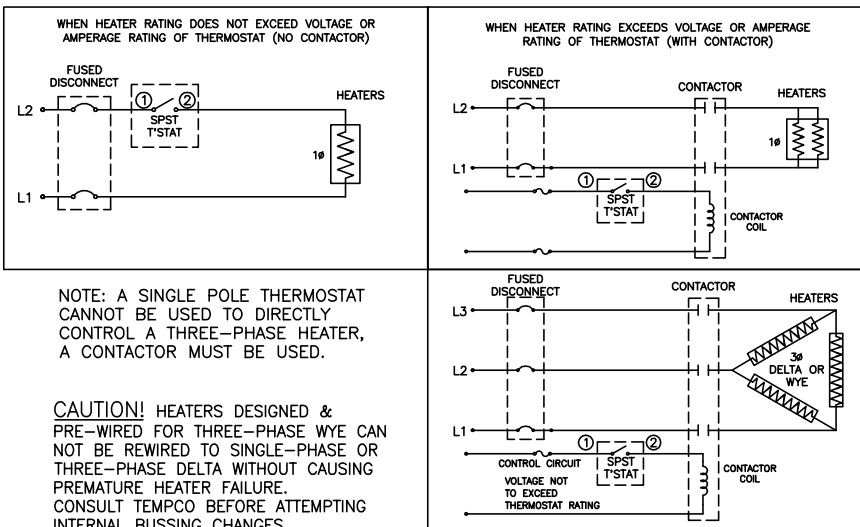


WARNING! HAZARD OF ELECTRIC SHOCK. DISCONNECT POWER BEFORE SERVICING OR INSTALLING HEATER. INSTALLATION MUST BE GROUNDED TO EARTH TO AVOID SHOCK HAZARD.

1Ø PARALLEL
ELEMENTS
2 CIRCUITS
3 ELEMENTS/CIRCUIT




3Ø WYE
1 CIRCUIT
2 SERIES
ELEMENTS/Ø

(HIGH VOLTAGE
CONNECTION FOR
DUAL VOLTAGE
HEATERS)

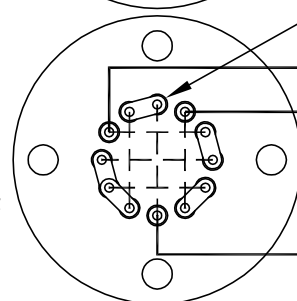


3Ø WYE
1 CIRCUIT
2 PARALLEL
ELEMENTS/Ø


(LOW VOLTAGE
CONNECTION FOR
DUAL VOLTAGE
HEATERS)

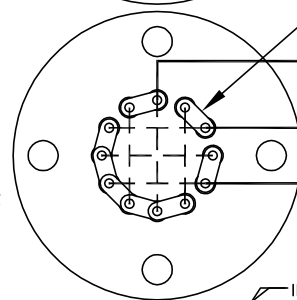

3Ø DELTA
2 CIRCUITS
1 ELEMENT/Ø




INTERNAL
BUSSBAR (8)

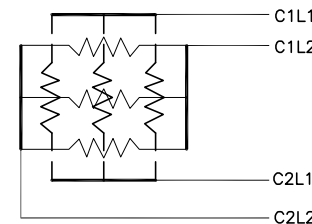


TO FUSED
DISCONNECTS,
OR
CONTACTORS

INTERNAL
BUSSBAR (5)




TO FUSED
DISCONNECT,
OR
CONTACTOR

INTERNAL
BUSSBAR (8)



TO FUSED
DISCONNECT,
OR
CONTACTOR

INTERNAL BUSSBARS (4)
& (2) CROSSOVER WIRES

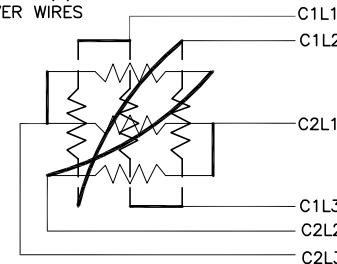

TO FUSED
DISCONNECTS,
OR
CONTACTORS

SEE REVERSE FOR ADDITIONAL
HEATER ELEMENT WIRING & BUSSING